


NOTES:

1. WATER METER TO BE INSTALLED BY A CERTIFIED PLUMBER OR WATER METER INSTALLER.
2. A RESIDENTIAL HOMEOWNER MAY INSTALL THEIR OWN WATER METER PROVIDING A BUILDING PERMIT IS OBTAINED.
3. WATER METERS SHALL BE PROVIDED, MAINTAINED, SEALED, REPLACED, REPAIRED, TESTED, INSPECTED OR REMOVED BY THE PUC.
4. WATER SERVICE PIPE SHALL BE SUPPORTED SUFFICIENTLY AND IN COMPLIANCE WITH THE ONTARIO BUILDING CODE SO THAT THE REMOVAL OF THE WATER METER BY THE PUC SHALL NOT AFFECT THE INTEGRITY OF THE SERVICE PIPE.
5. NO CONNECTIONS ARE PERMITTED BETWEEN THE BUILDING CONTROL VALVE AND THE SHUT OFF VALVE DOWNSTREAM OF THE WATER METER.
6. OWNERS SHALL ENSURE THAT ALL VALVES ARE VISIBLE, ACCESSIBLE AND MAINTAINED IN GOOD WORKING ORDER AT ALL TIMES.
7. FULL PORT, GATE OR BALL VALVES SHALL BE USED FOR ALL WATER METER INSTALLATIONS.
8. OWNERS ARE RESPONSIBLE FOR DAMAGE TO METERS

CLEARANCES:

1. NOT LESS THAN 300MM AND NOT MORE THAN 900MM TO CENTRE LINE ABOVE FLOOR LEVEL.
2. NOT LESS THAN 300MM FROM THE FOUNDATION OR EXTERIOR WALL.
3. NOT LESS THAN 600MM ABOVE THE TOP OF THE METER (HORIZONTAL INSTALLATION)
4. NOT LESS THAN 500MM FROM ANY PARTITION OR OBSTRUCTION
5. NOT LESS THAN 1M FROM ANY INTERNAL STRUCTURE (IE. FURNACE, WATER HEATER, ETC.)

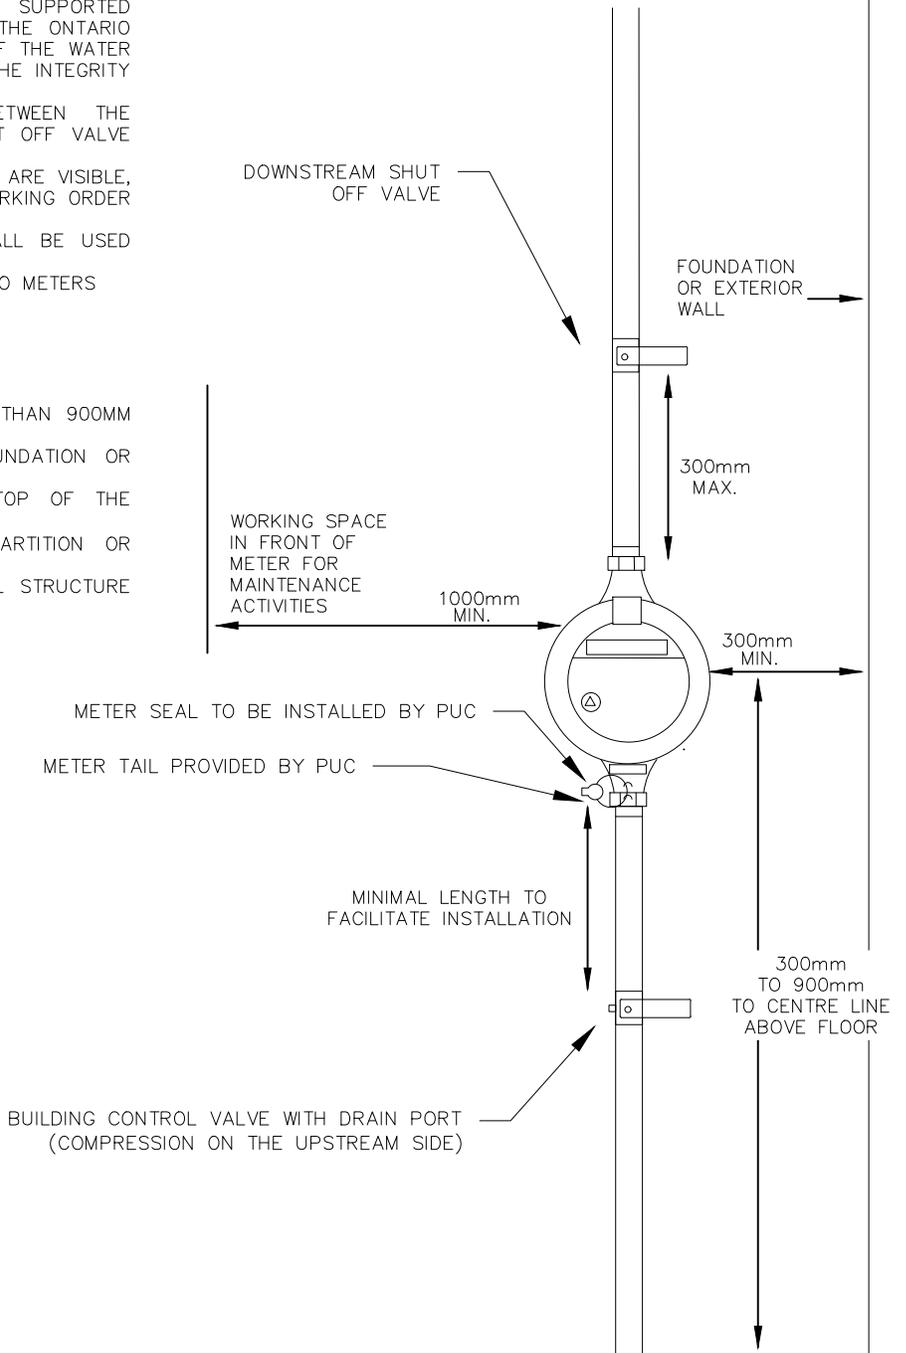

PETERBOROUGH UTILITIES COMMISSION

STANDARD WATERWORKS DRAWING

| | | | | | |
|---|------------|--|------------|----------|------|
|  | TITLE | TYPICAL RESIDENTIAL METER INSTALLATION | No. | REVISION | DATE |
| | | | 1. | | |
| | | | 2. | | |
| DRAWN BY | J. ELLISON | APPROVED | A3113 | | |
| DESIGNED | J. ELLISON | DATE: | 02-08-2023 | | |