
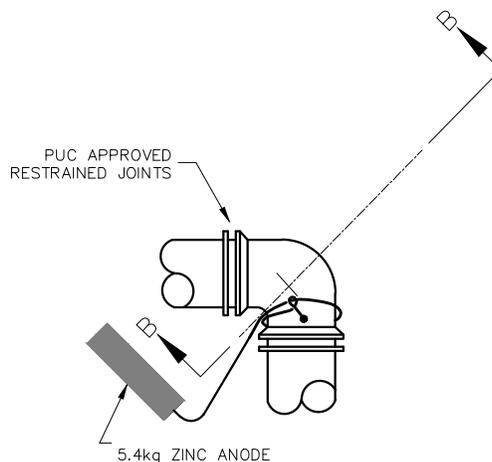
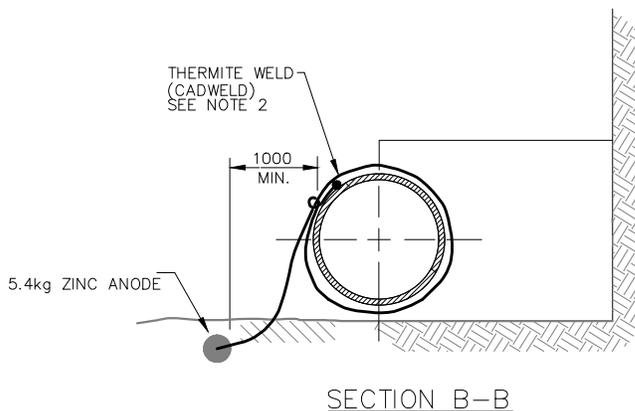
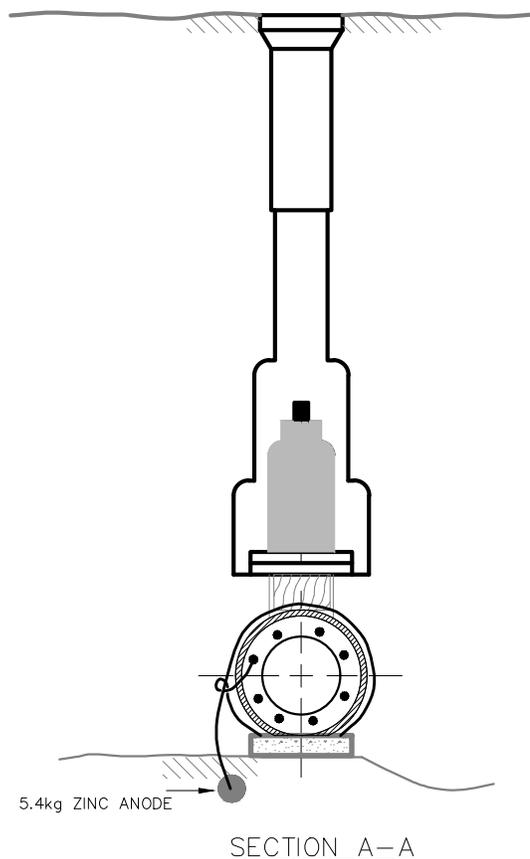


N.T.S.

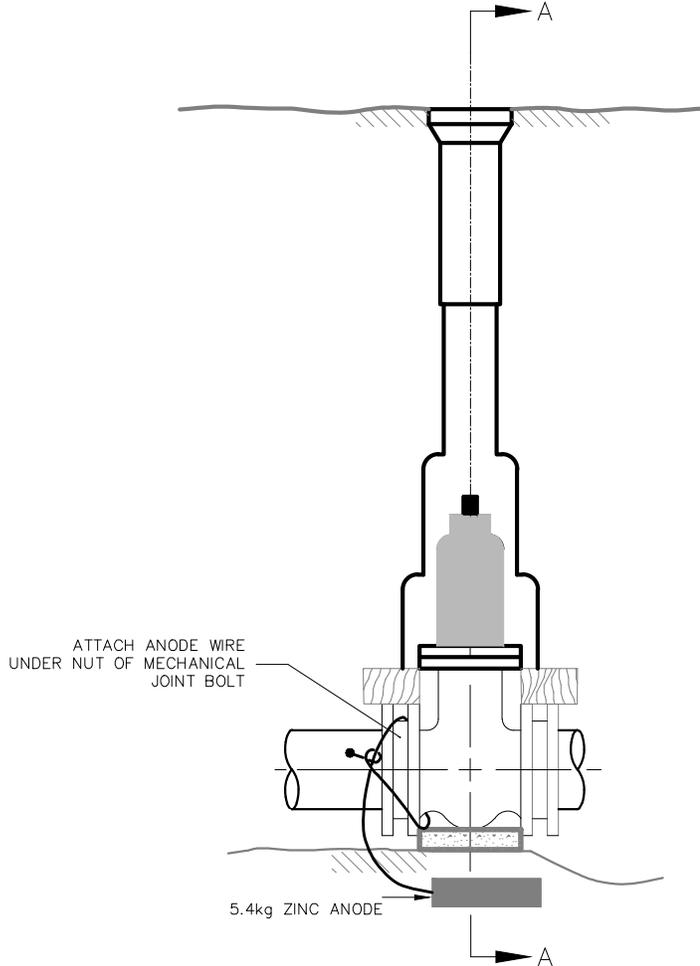

ALL DIMENSIONS IN MILLIMETERS

NOTES:

1. ANODE TO BE PLACED AT LEAST 1.0 m AWAY FROM THE FITTING AND AS DEEP AS THE BOTTOM OF THE FITTING. MINIMUM DISTANCE BETWEEN ANODES TO BE 1.0 m.
2. ALL WELDED CONNECTIONS TO BE COATED WITH ROYSTON "HANDY CAP" OR APPROVED EQUIVALENT.
3. ALL CATHODIC PROTECTION AS PER DWG. A2732
4. HYDRANTS TO HAVE A 10.9kg ZINC ANODE CADWELDED TO "SHOE" OF HYDRANT
5. MAIN STOPS AND CURB STOPS TO HAVE A 5.4kg ZINC ANODE ATTACHED TO TAIL NUT TERMINAL.

PETERBOROUGH UTILITIES COMMISSION

STANDARD WATERWORKS DRAWING

	TITLE CATHODIC PROTECTION FOR VALVES AND METALLIC FITTINGS ON NON-METALLIC PIPE	No.	REVISION	DATE	
	DRAWN BY: J. ELLISON	APPROVED: K. CONLIN	1.	REVISED NOTES	02-28-2023
	DESIGNED: J. ELLISON	DATE: 02-08-2023	2.	ADDED ZINC ANODES, NON-METALLIC SERVICE	02-28-2023
A2733					