


## NOTES

1. PHYSICAL SEPARATION MUST BE MAINTAINED AT ALL CONNECTION POINTS OF NEW OR REHABILITATED WATERMAINS TO THE EXISTING SYSTEMS UNTIL BACTERIOLOGICAL TESTS HAVE PASSED.
2. CONNECTION OF THE WATERMAIN TO BE COMPLETED AS PER PUC CONSTRUCTION SPECIFICATIONS SECTION 2.4.19. ONLY AFTER RECEIPT OF AUTHORIZATION BY THE PUC ENGINEER.
3. CONTRACTOR IS RESPONSIBLE FOR DESIGN, INSTALLATION AND MAINTENANCE OF THRUST BLOCKS THROUGHOUT CONSTRUCTION.
4. DEPRESSURIZATION POINT TO REMAIN OPEN WHENEVER STAFF ARE IN ACCESS PIT.
5. BACKFLOW TO BE SELECTED AND FIELD TESTED IN ACCORDANCE WITH CSA STANDARDS B64.10 AND B64.10.1
6. **UNRESTRAINED WATERMAIN UNDER PRESSURE IS NOT ALLOWED IN ACCESS PITS AT ANY TIME**
7. ADEQUATE RESTRAINT IS THE RESPONSIBILITY OF THE CONTRACTOR
8. ASSUME EXISTING WATERMAIN IS NOT RESTRAINED

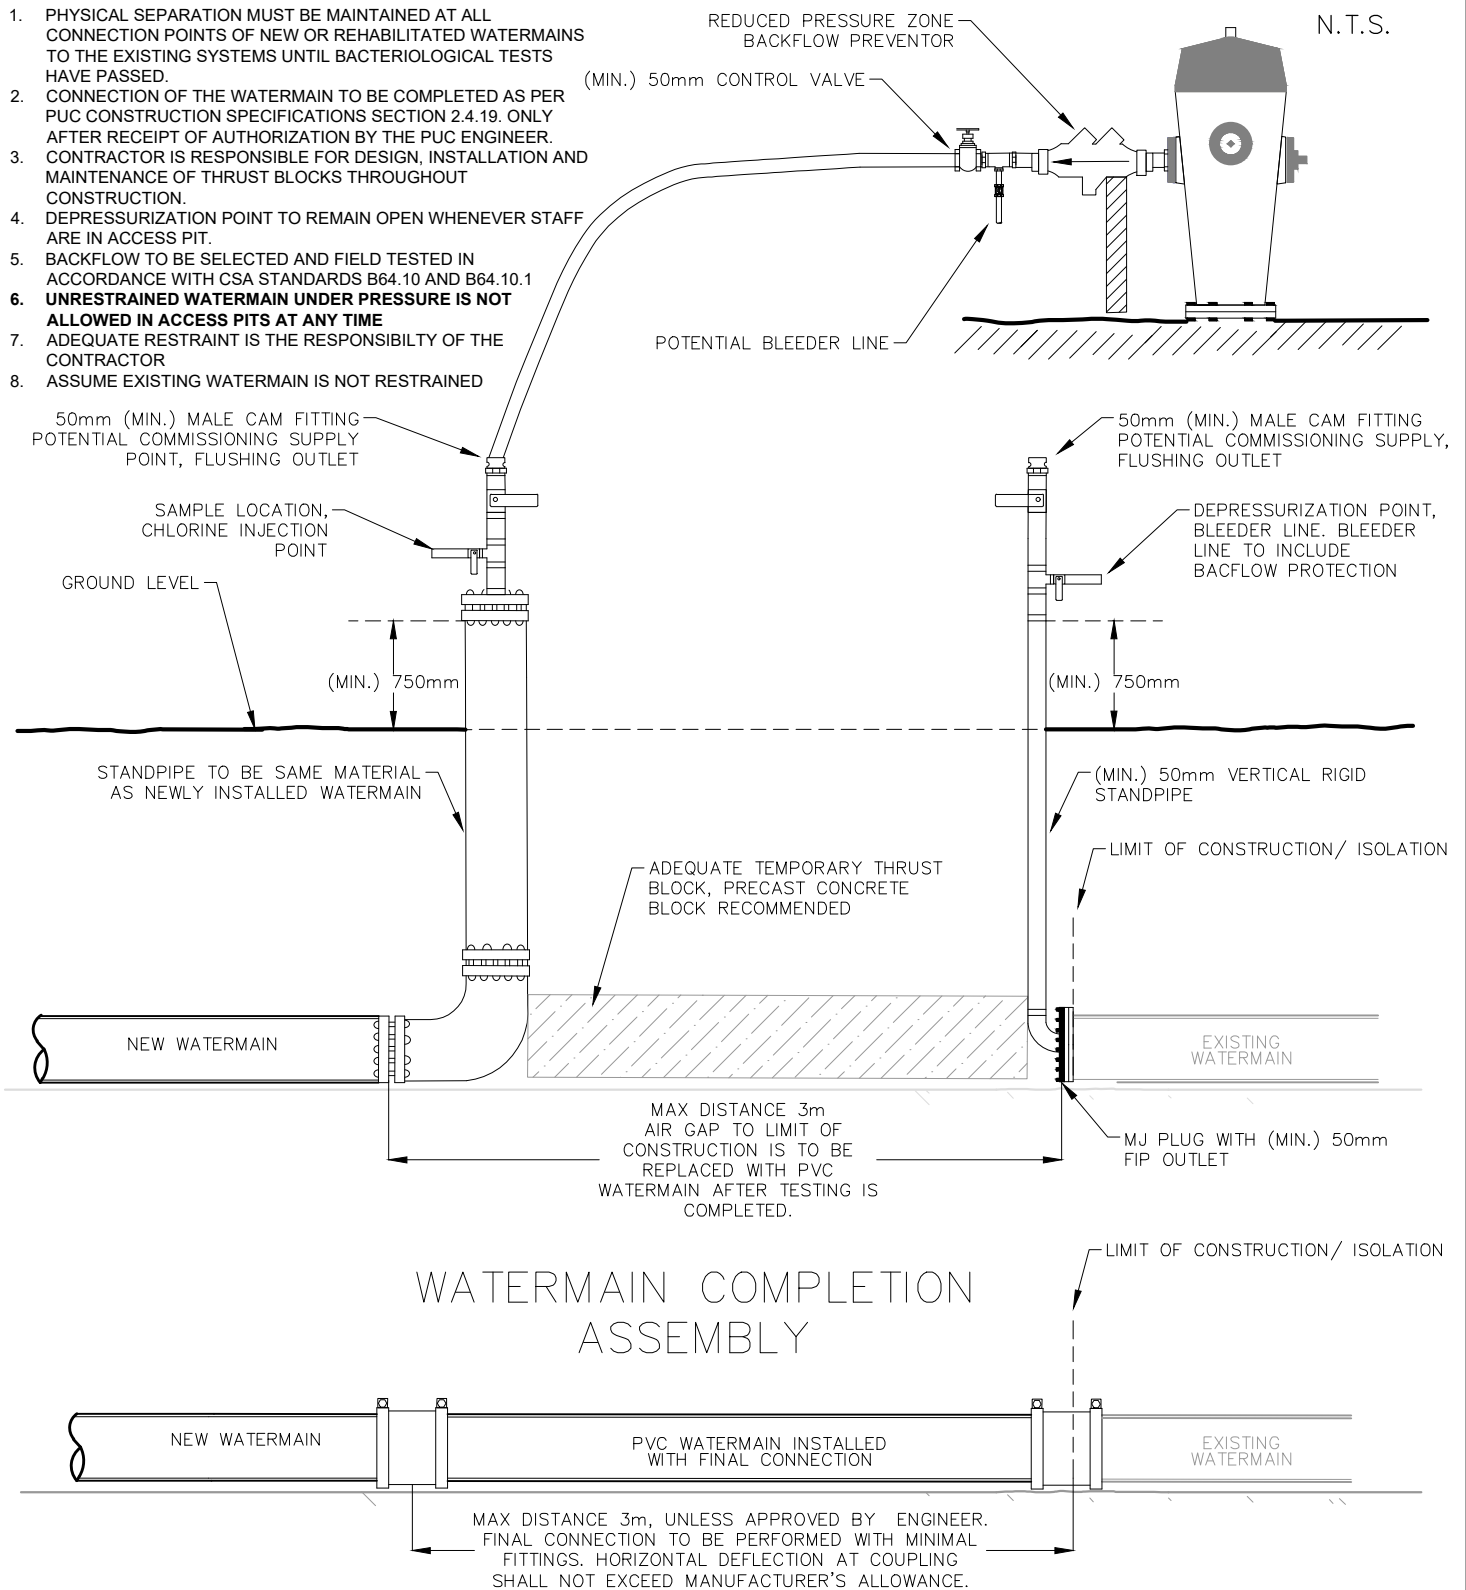

# PETERBOROUGH UTILITIES COMMISSION

## STANDARD WATERWORKS DRAWING



TITLE  
ALTERNATIVE POTABLE WATER SUPPLY  
FOR TESTING NEW, REPLACED AND  
LINED WATERMAIN

No.	REVISION	DATE
1.	ADDED STANDPIPES	01-11-2024
2.	ADDED NOTE 6-8	2025-01-15

DRAWN BY J. ELLISON

APPROVED K. CONLIN

DESIGNED J. ELLISON

DATE: 02-12-2019

A3085