



NOTES:

N.T.S.

1. PUC TO BE NOTIFIED A MINIMUM OF 48 HOURS IN ADVANCE OF WATERMAIN CROSSING.
2. PUC WILL REQUIRE THE WATERMAIN TO BE ISOLATED IF MORE THAN 1m OF WATERMAIN IS UNDERMINED.

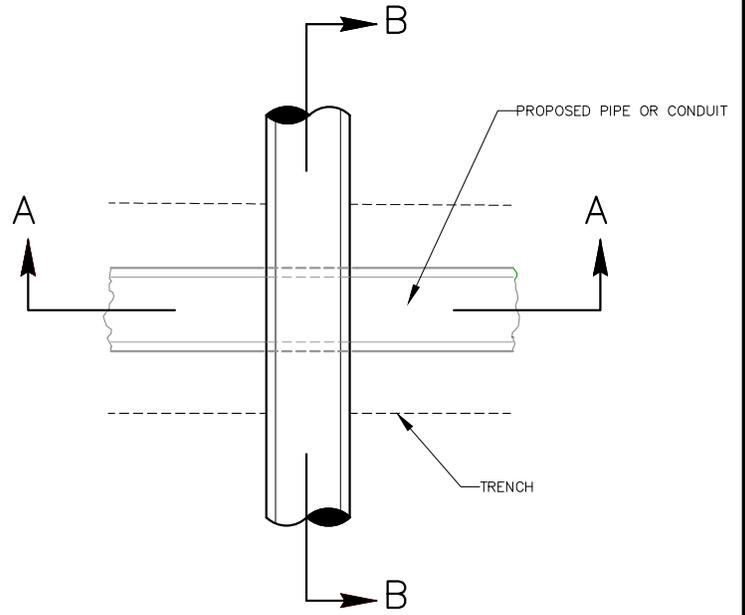

PLAN

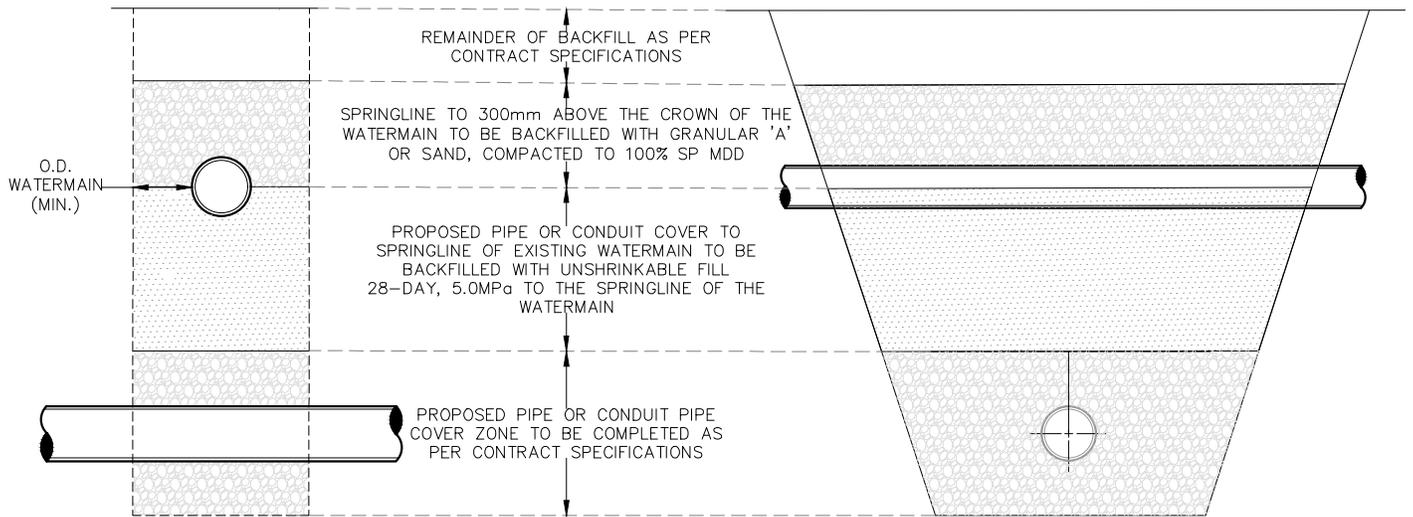

LONGITUDINAL SECTION 'A-A'

CROSS SECTION 'B-B'

PETERBOROUGH UTILITIES COMMISSION

STANDARD WATERWORKS DRAWING



TITLE

TYPICAL BACKFILLING OF UNDERMINED WATERMANS LESS THAN 300mm DIA.

No.	REVISION	DATE
1.	UPDATED TITLE BLOCK, UNSHRINKABLE FILL REQ.	10-25-2023
2.		

DRAWN BY: J. ELLISON

APPROVED: K. CONLIN

DESIGNED: J. ELLISON

DATE: 10-25-2023

A2373