


N.T.S.

NOTES:

1. REFER TO PUC APPROVED MANUFACTURER'S PRODUCTS www.peterboroughutilities.ca FOR APPROVED PRODUCTS.
2. SERVICE POST AND SAMPLING STATION ARE TO BE ADEQUATELY BRACED DURING BACKFILLING.
3. SAMPLE STATIONS SHOULD BE LOCATED ON PROPERTY LINE OR 300mm TOWARDS CURB, BUT SHALL NOT BE INSTALLED ON PRIVATE PROPERTY.
4. ALL WATER SERVICING TO BE AT RIGHT ANGLES TO THE WATERMAIN UNLESS APPROVED OTHERWISE.
5. CORPORATION MAIN STOPS AND CURBSTOPS TO HAVE 5.4kg ZINC ANODES ATTACHED TO TERMINAL NUT.
6. LOCATION OF SAMPLING STATION TO BE APPROVED BY THE PUC PRIOR TO INSTALLATION.
7. NOT TO BE INSTALLED IN AREAS WITH HIGH GROUND WATER.

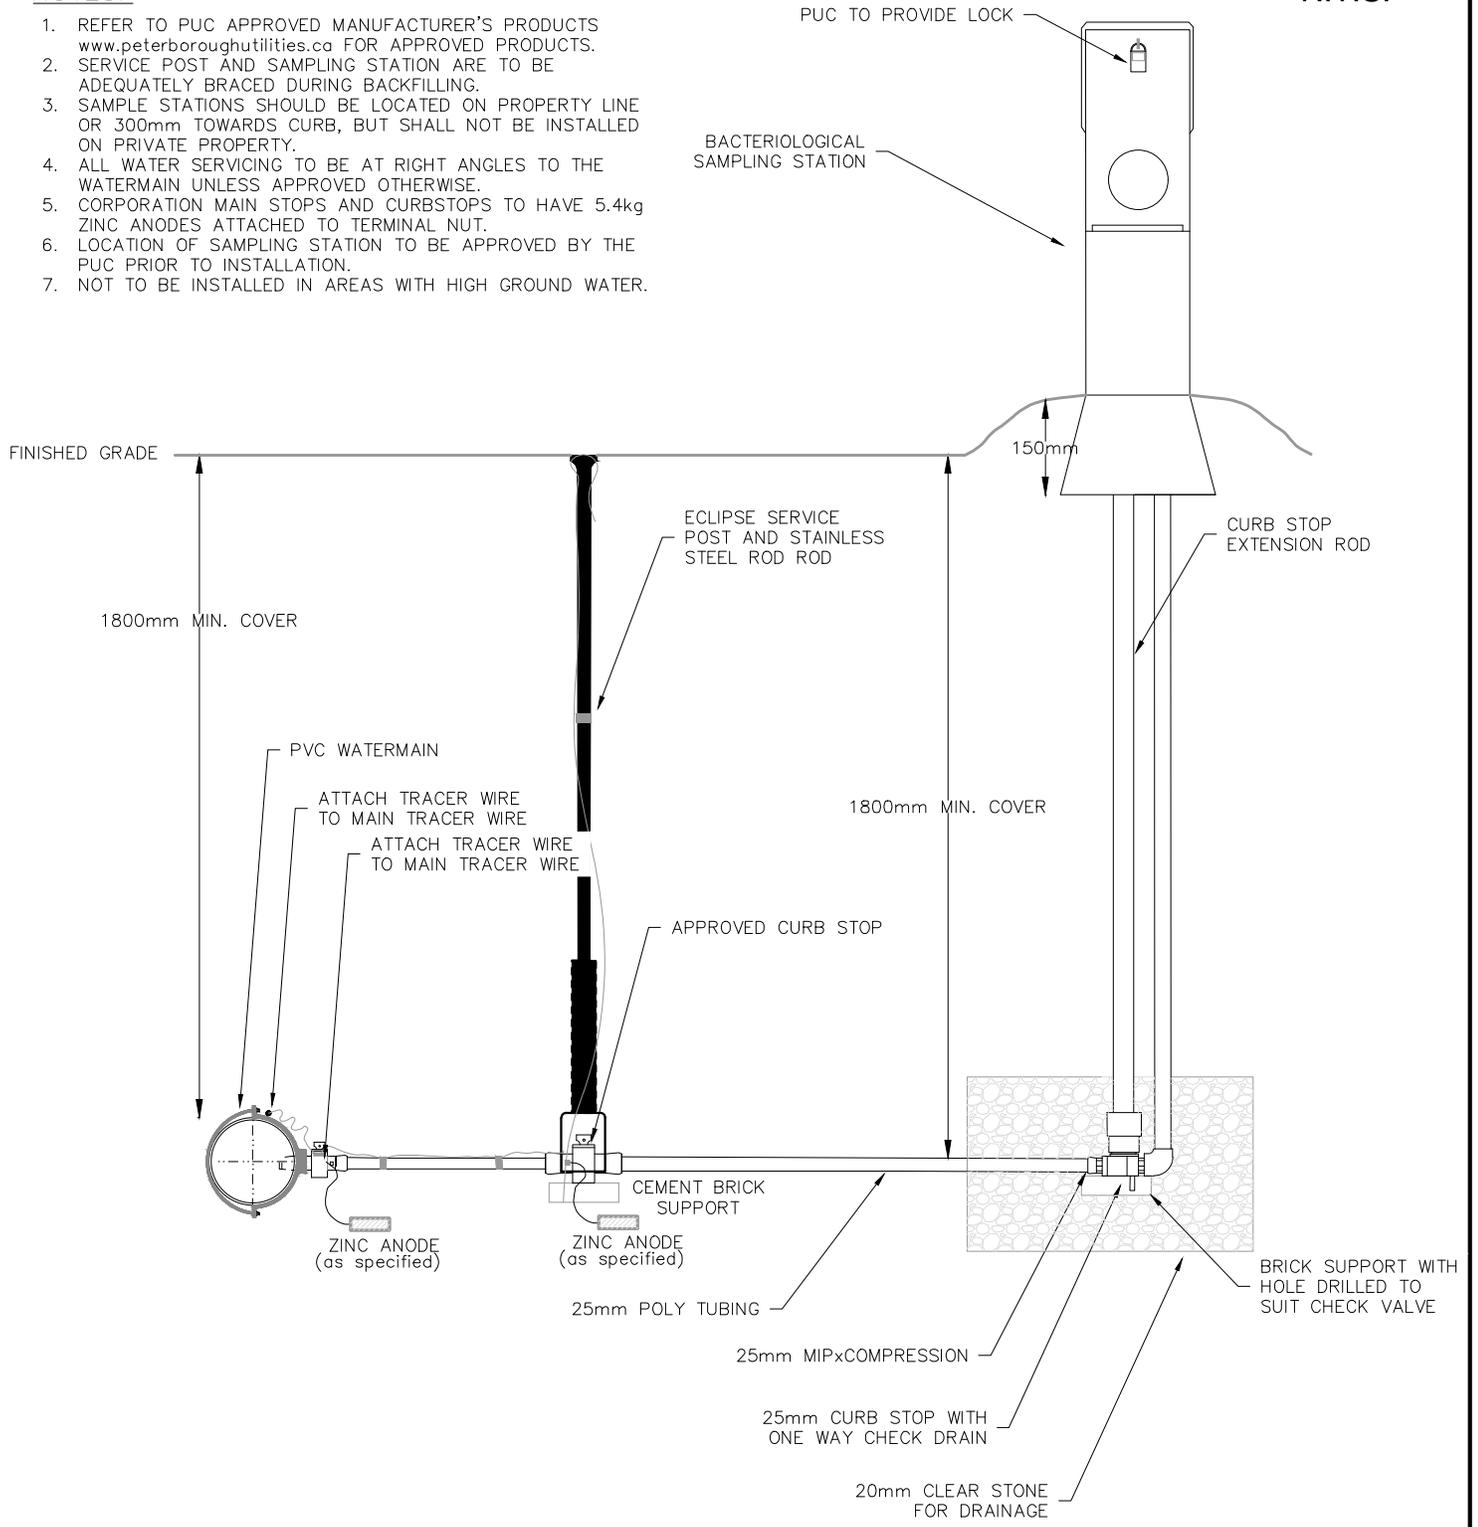

PETERBOROUGH UTILITIES COMMISSION
STANDARD WATERWORKS DRAWING

	TITLE	No.	REVISION	DATE
	WATER DISTRIBUTION SAMPLING STATION	1.	UPDATED SAMPLE STATION	10-23-2023
		2.	STOP AND DRAIN CURBSTOP WITH CHECK VALVE	10-23-2023
DRAWN BY J. ELLISON	APPROVED K. CONLIN	A2421		
DESIGNED J. ELLISON	DATE: 10-23-2023			