


NOTES

N.T.S.

1. PHYSICAL SEPARATION MUST BE MAINTAINED AT ALL CONNECTION POINTS OF NEW OR REHABILITATED WATERMANS TO THE EXISTING SYSTEMS UNTIL BACTERIOLOGICAL TESTS HAVE PASSED.
2. CONNECTION OF THE WATERMAIN TO BE COMPLETED AS PER PUC CONSTRUCTION SPECIFICATIONS SECTION 2.4.19. ONLY AFTER RECEIPT OF AUTHORIZATION BY THE PUC ENGINEER.
3. CONTRACTOR IS RESPONSIBLE FOR DESIGN, INSTALLATION AND MAINTENANCE OF THRUST BLOCKS THROUGHOUT CONSTRUCTION.
4. DEPRESSURIZATION POINT TO REMAIN OPEN WHENEVER STAFF ARE IN ACCESS PIT.
5. BACKFLOW TO BE SELECTED AND FIELD TESTED IN ACCORDANCE WITH CSA STANDARDS B64.10 AND B64.10.1
6. **UNRESTRAINED WATERMAIN UNDER PRESSURE IS NOT ALLOWED IN ACCESS PITS AT ANY TIME**
7. ADEQUATE RESTRAINT IS THE RESPONSIBILITY OF THE CONTRACTOR
8. ASSUME EXISTING WATERMAIN IS NOT RESTRAINED

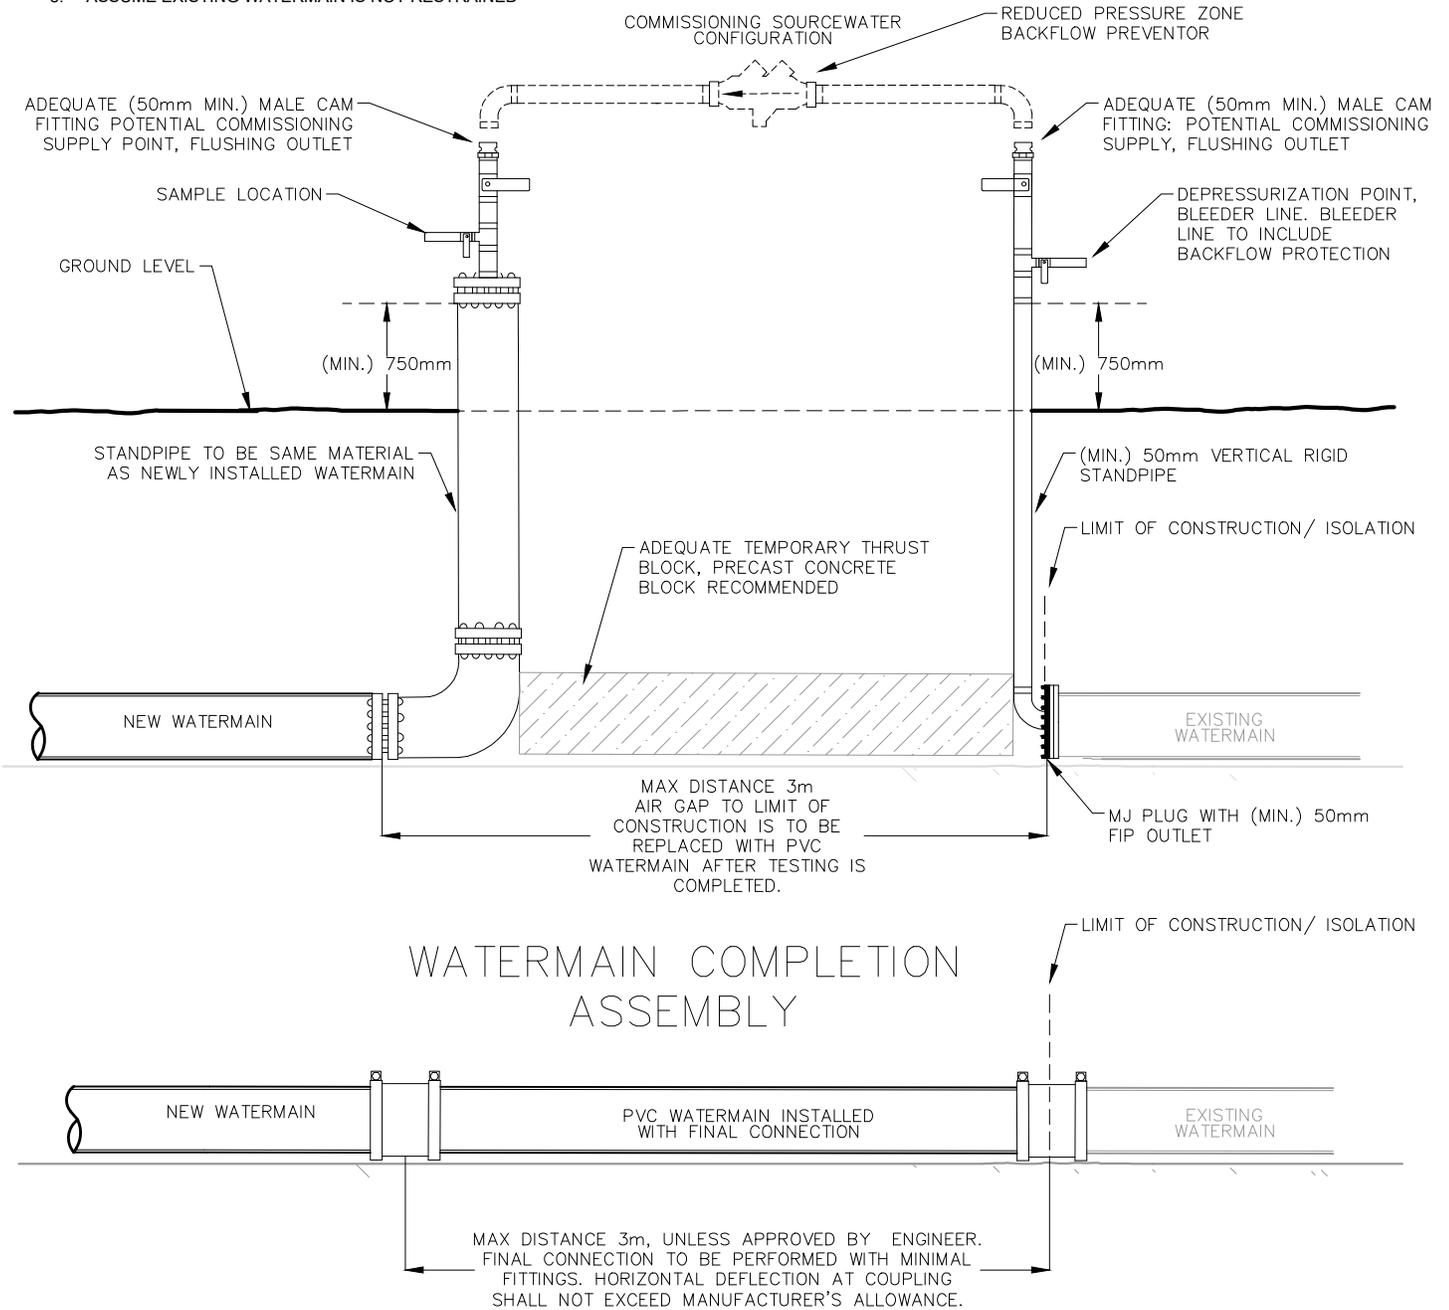

PETERBOROUGH UTILITIES COMMISSION
STANDARD WATERWORKS DRAWING

	TITLE	No.	REVISION	DATE
	PHYSICAL SEPARATION REQUIRED FOR NEW CONSTRUCTION	1.	ADDED NOTE 6-8	2025-01-15
		2.		
DRAWN BY: J. ELLISON	APPROVED: K. CONLIN	A3121		
DESIGNED: J. ELLISON	DATE: 01-11-2023			