
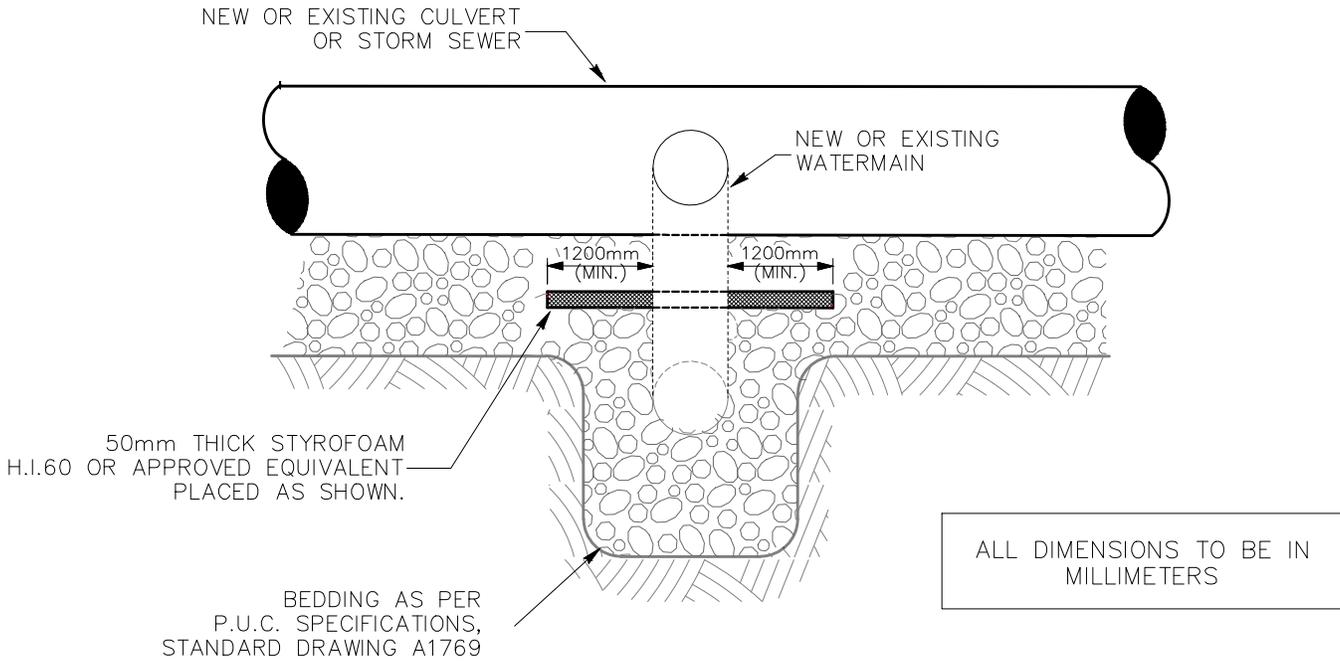


NOTE

1. *WATERMAIN INSTALLATIONS BEYOND 6m (TOTAL PIPE) REQUIRE SUBMISSION OF A COMMISSIONING PLAN AND PUC APPROVAL.
2. THRUST BLOCKS ARE REQUIRED WHEN EXISTING WATERMAIN HAS UNRESTRAINED JOINTS.

N.T.S.

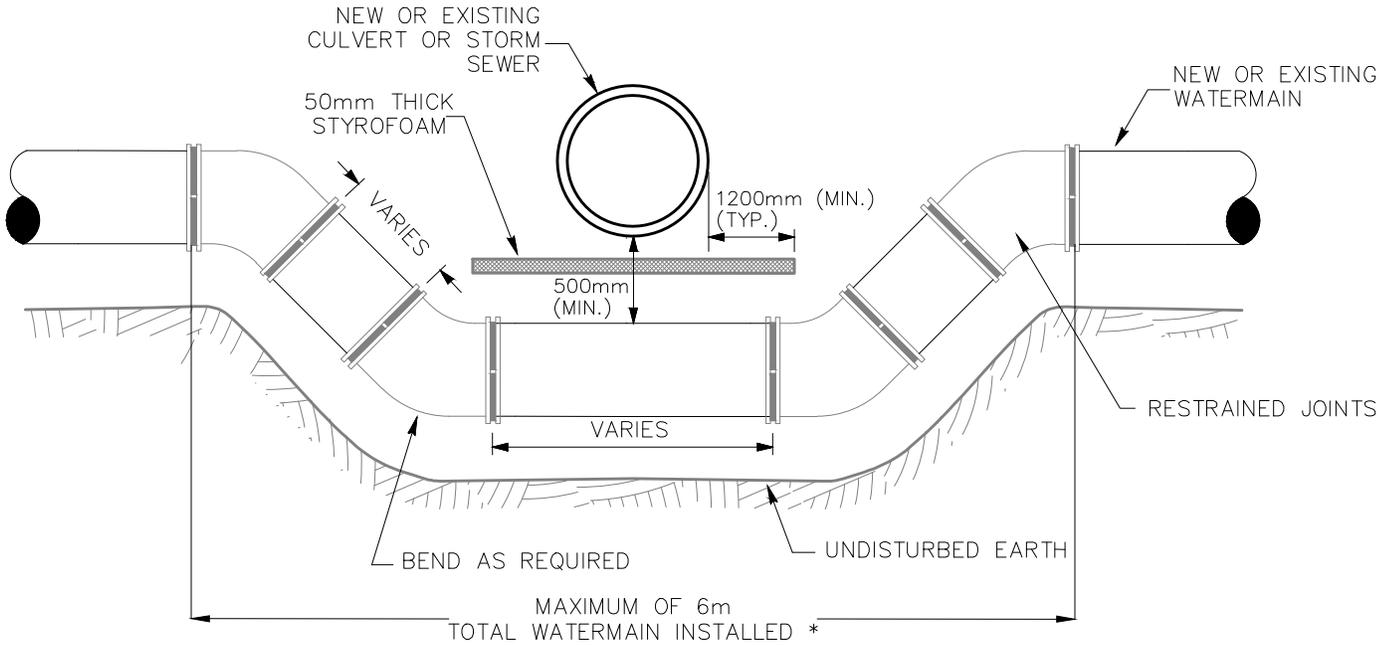

PETERBOROUGH UTILITIES COMMISSION
STANDARD WATERWORKS DRAWING

	TITLE	<p>LOWERING OF EXISTING WATERMAIN AT SANITARY OR STORM SEWER</p>	No.	REVISION	DATE	
	DRAWN BY: J. ELLISON		APPROVED: K. CONLIN	1.	INSULATION DIMENSIONS	01-25-2016
	DESIGNED: J. ELLISON		DATE: 10-30-2023	2.	MAX. 6m WATERMAIN COMMENT	10-30-2023
			A2000			